


- NOTES:
1. ALL WIRE CONNECTION SHALL BE MADE WITH APPROVED CONNECTORS.
 2. MAKE ALL WIRE SPLICES IN VALVE BOXES.
 3. LEAVE A MINIMUM OF 12" EXTRA WIRE AT ALL SPLICE POINTS.
 4. MAXIMUM DISTANCE FROM DECODER TO VALVE = 150 FEET

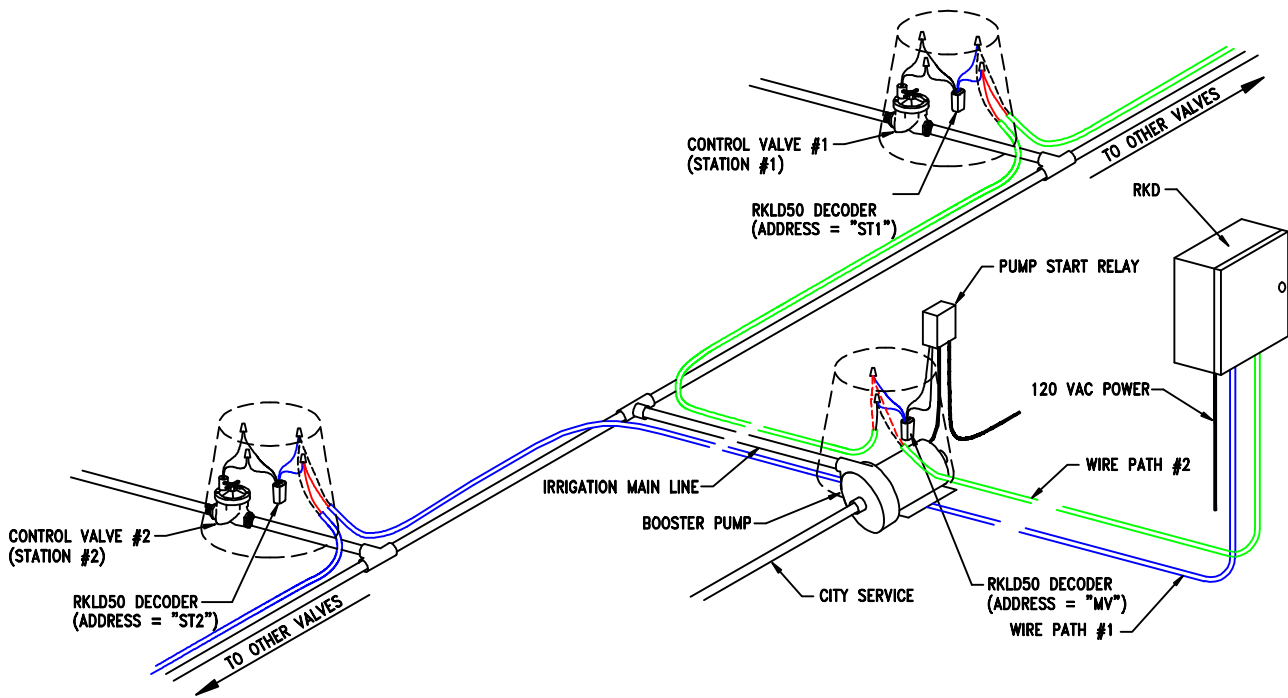

○ RKD
Scale: No Scale

BOOSTER/SUCTION LIFT PUMP (TYPICAL)