


NOTES:

1. ALL WIRE CONNECTION SHALL BE MADE WITH APPROVED CONNECTORS.
2. MAKE ALL WIRE SPLICES IN VALVE BOXES.
3. LEAVE A MINIMUM OF 12" EXTRA WIRE AT ALL SPLICE POINTS.
4. MAXIMUM DISTANCE FROM DECODER TO VALVE = 150 FEET
5. WIRE LENGTHS INCLUDED MASTER VALVE AND TWO BOOSTER PUMPS RUNNING USING #16/2 TUCOR WIRE.

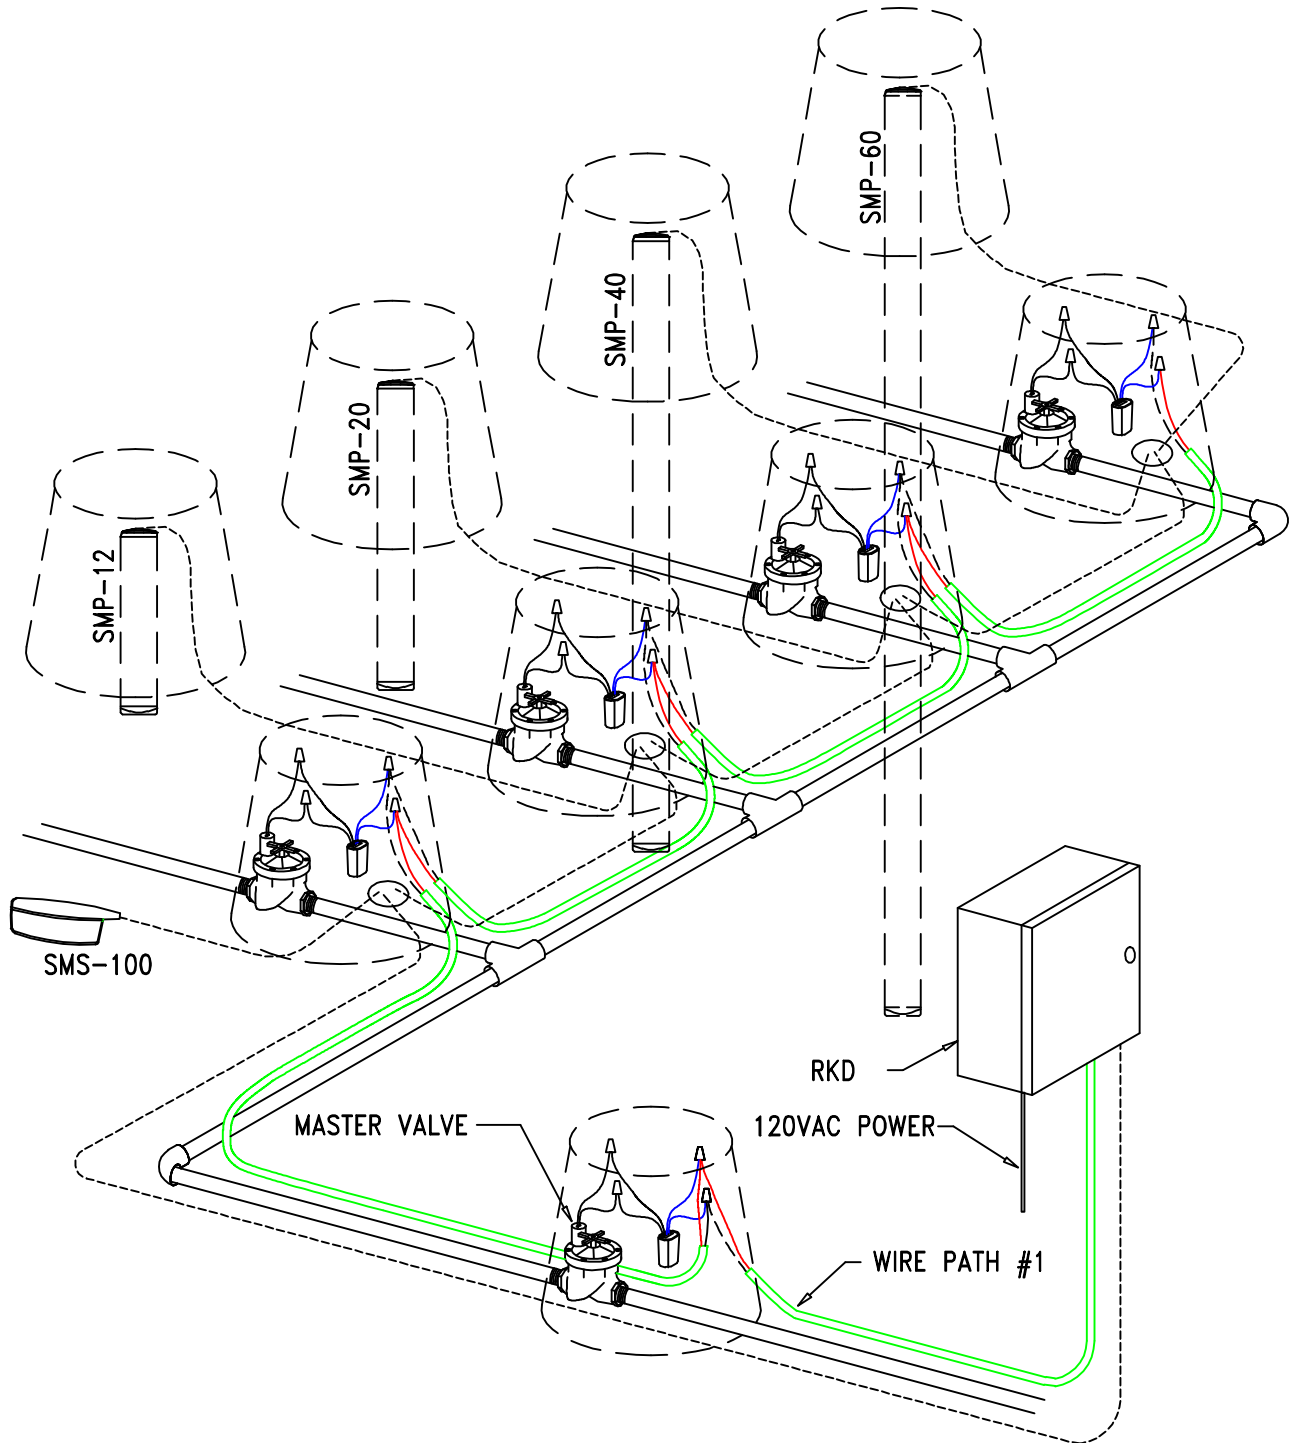

 RKD
Scale: No Scale

SMS/SMP