


TWC & TWI Station Naming

The following items should be taken into consideration when naming stations in the Tucor TWC (Flowmaster & TWC-NV) and TWI (TWC-NV Web) irrigation controllers:

- Character use
 - Full alphabet (DIP switch 12 set to O (open), this is default)
 - A - Z
 - 0 - 9
 - No special characters
 - No spaces (blanks)
 - Limited alphabet – for Remote Field Access (RFA) (DIP switch 12 set to C (closed), this is not the factory default)
 - B D G L S
 - 0 - 9
- The station name cannot be edited on the web if entered manually at the controller and a space (blank) is used within the station name (i.e. “ST 0 1” or “R1 A”).
- When naming stations in Cycle Manager, use the “Tab” button on your keyboard to navigate from field to field

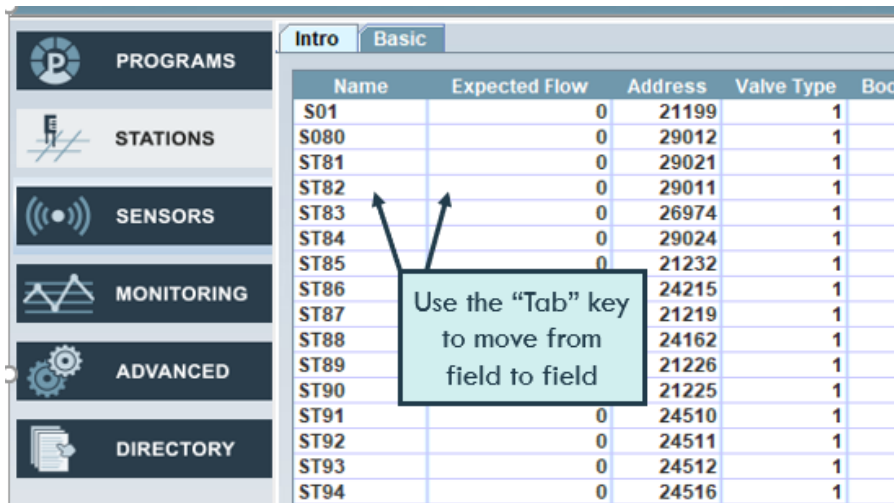

Name	Expected Flow	Address	Valve Type	Boo
S01	0	21199	1	
S080	0	29012	1	
ST81	0	29021	1	
ST82	0	29011	1	
ST83	0	26974	1	
ST84	0	29024	1	
ST85	0	21232	1	
ST86		24215	1	
ST87		21219	1	
ST88		24162	1	
ST89		21226	1	
ST90		21225	1	
ST91	0	24510	1	
ST92	0	24511	1	
ST93	0	24512	1	
ST94	0	24516	1	

For additional support, please contact Tucor directly:

support.tucor.com

1-800-272-7472

www.tucor.com